

SEDE

Via Martelli, 26 - 40138 Bologna
Tel. (051) 534015 - Fax. (051) 530085

CERTI.CER.

LABORATORIO DI ZONA

Via Valle d'Aosta, 1 - 41049 Sassuolo
Tel. e Fax. (0536) 802154

Part. IVA 0094778-0375

Bologna

20/02/06

Spett.le
CIPA GRES S.p.A.
Via Statale 467, 119
42013 CASALGRANDE (RE)

TEST LABORATORY

TEST REPORT N° 3050/06

concerning ceramic tiles according to EN 14411 (ISO 13006)

(translation of test report Nr. 3049/06 of 20/02/06)

Requested by:	CIPA GRES S.p.A. Via Statale 467, 119 42013 CASALGRANDE (RE)
On (date):	13/02/06
For the sample marked:	"Articolo POMPEI STAR 20x20 - 8/9mm".

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our supervision.

The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 3 pages this cover included.



Consorzio universitario per la gestione del
«Centro di ricerca e sperimentazione per
l'industria ceramica».
D.P.R. 10-4-1978 n. 806
(G.U. 20-12-1978 n. 353)

Laboratorio autorizzato ad effettuare il
servizio di rilevamento dell'inquinamento
atmosferico.
Decreto MINISTERO SANITÀ 10-8-1974
(G.U. 14-9-1974 n. 240)

Laboratorio iscritto nell'albo dei «Laboratori Esterni
Pubblici e Privati Altamente Qualificati».

Decreto MINISTERO RICERCA SCIENTIFICA 6-6-1983
(G.U. 6-7-1983 n. 183)

Membro ASTM

American Society for
Testing and Materials.

Test report N. 3050/06 Date 20/02/06

Page 2 of 3

Description of the sample:

Unglazed ceramic tiles 20 x 20 x 0,8 cm marked
"Articolo POMPEI STAR 20x20 - 8/9mm".

Manufacturer: CIPA GRES S.p.A.

Sampling details:

- Where: -----
- Date: -----
- By whom: CUSTOMER
- How (methods): -----

DATE OF RECEIVAL IN LABORATORY: 14/02/06

TESTS PERFORMED:

		Date of starting	Date of ending
☒	DIN 51130 Determination of the anti - slip properties - (06/2004) Workrooms and fields of activities with raised slip danger, walking method - ramp test	15/02/06	15/02/06

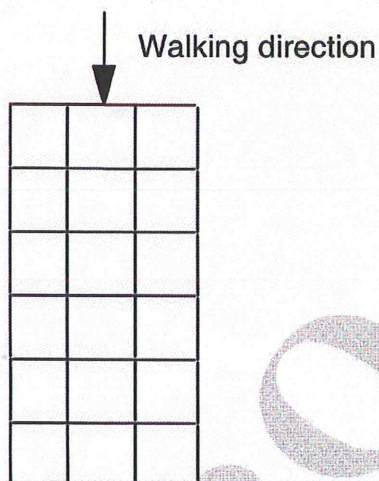
DIN 51130 (06/2004)- Determination of the anti - slip properties –
Workrooms and fields of activities with raised slip danger, walking
method – ramp test

Surface characteristics

- ☐ Smooth
☒ Profiled
☐ Structured
☐ Rough

OPERATIVE CONDITIONS

Fixing scheme

**RESULTS**

Average total acceptance angle:

28°

Movement area (cm³/dm²):

5,0

CLASSIFICATION (BGR 181- 10/2003)

Group of anti - slip properties:

R12

Movement area evaluation group:

V4